



Fault Prognostics for the Predictive Maintenance of Wind Turbines: State of the Art

Koceila Abid^{1,2(✉)}, Moamar Sayed Mouchaweh^{1(✉)}, and Laurence Cornez^{2(✉)}

¹ IMT Lille Douai, Lille University, Lille, France

{koceila.abid,moamar.sayed-mouchaweh}@imt-lille-douai.fr

² CEA LIST, DM2I, LADIS, Gif-sur-Yvette Cedex, France

{koceila.abid,laurence.cornez}@cea.fr

Abstract. Reliability and availability of wind turbines are crucial due to several reasons. On the one hand, the number and size of wind turbines are growing exponentially. On the other hand, installation of these farms at remote locations, such as offshore sites where the environment conditions are favorable, makes maintenance a more tedious task. For this purpose, predictive maintenance is a very attractive strategy in order to reduce unscheduled downtime and maintenance cost. Prognostic is an online technique that can provide valuable information for proactive actions such as the current health state and the Remaining Useful Life (RUL). Several fault prognostic works have been published in the literature. This paper provides an overview of the different prognostic phases, including: health indicator construction, degradation detection, and RUL estimation. Different prognostic approaches are presented and compared according to their requirements and performance. Finally, this paper discusses the suitable prognostic approaches for the proactive maintenance of wind turbines, allowing to address the latter challenges.

Keywords: Fault prognostics · Remaining useful life · Predictive maintenance · Wind turbines

1 Introduction

The production of electricity using wind energy has an increasing trend in the last decade especially in Europe. It is reported in [1] that the wind energy has become the second source of energy in Europe behind the gas. This trend entails a growing evolution in the number and size of wind turbines (WTs), which lead to increase the cost of Operation and Maintenance (O&M). The cost of O&M for one wind turbine is about 20–30% of overall lifetime costs of energy.

Traditional maintenance strategies such as curative maintenance or preventive maintenance have a main drawback that is the fault is undergone by the system. Prognostics and Health Management (PHM) or predictive maintenance provides an advanced maintenance strategy that can enhance the reliability and

availability while reducing unscheduled fault and maintenance cost of systems such as WT. Health monitoring of WTs is achieved by monitoring the performance of the WT (e.g., power curve) [10] or condition monitoring of components, in particular critical components as rotating machinery (e.g., generator). Fault prognostic is an important step of the predictive maintenance. It can be defined as the prediction of when a failure might take place or the estimation of the Remaining Useful Life (RUL), which is the time between degradation detection and failure threshold. It is an online technique that can provide valuable information for proactive actions allowing mitigating the fault consequences and/or scheduling maintenance steps. RUL prediction of critical components is a very challenging task due to sensor noise, complexity of the system, and prediction uncertainty caused by the switch between operating conditions, and environment variability (e.g., wind speed and direction).

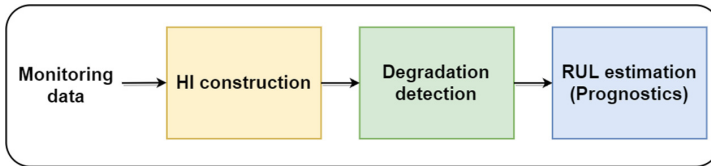


Fig. 1. General approach of prognostic.

The general approach of prognostic is presented in Fig. 1. It indicates the three main steps of prognostics: Health Indicator (HI) construction, Degradation detection and RUL estimation. First the HI is constructed by processing monitoring data in order to monitor the evolution of system performance over time. The second step is the degradation detection triggered as soon as the HI goes below a predefined threshold. The third step is the aims at predicting the degradation evolution and estimating the time when the system will go below a failure threshold. In this review, the techniques used to perform the different steps of the prognostic approach are presented and compared in terms of requirements and performances within the context of wind turbines predictive maintenance. The suitable prognostic approaches for the proactive maintenance of wind turbines are discussed, allowing to address the latter challenges.

2 Health Indicator Construction

Health Indicator (HI) construction is the main step for achieving prognostic. It represents the evolution over time of the system performance. When this evolution is decreasing, this indicates a drift from normal or nominal operation conditions towards a failure. Concept drift techniques can be used to monitor the performance of systems by learning patterns from data streams gathered by sensors [20], where a new class is detected if there is a decrease in the system

performance according to its nominal value. HIs can be classified in two categories: physics health indicators and virtual health indicators which cannot be interpreted with physical sense. They can also be classified into HI based on a single feature such as using the raw data gathered from sensors, residuals based feature, time domain or time-frequency feature extracted from data measured by monitoring sensors. The second kind of HI is based on a fusion of multiple features that can perform better representation of the system health.

Single feature based HI is based on a single extracted feature which can be more interpretable. Most of prognostic works for wind turbine focused on the condition monitoring of WT rotating machine (e.g., low and high speed shaft, gearbox, generator) due to its criticality. Condition monitoring for such systems is achieved by using vibration signal, acoustic emission, oil analysis or current signal analysis. In the case of complex degradations, it is often hard to find one feature sensitive to those degradations. Therefore, it is unfeasible to construct a HI able to follow in the degradation evolution over time and to allow a reliable estimation of RUL. In order to tackle this problem, a solution is to fuse several features in order to exploit their complementarity. However, this fusion entails the lose of physics meaning (e.g., dimension reduction or distance between class in a feature space). This lose leads to a lack of HI interpretability so it represents a virtual description of the system performance health.

Several methods of HI construction based on a single and multiple features are proposed in the literature, which are summarized in Table 1.

2.1 Health Indicator Evaluation

HIs are evaluated using different criteria presented in [11]. The most pertinent HI evaluation criteria are monotonicity and trendability [9, 18, 36].

Monotonicity. The monotonicity evaluate the negative or positive trend of the HI, with the assumption that the system cannot self-heal [9, 18]. Monotonicity can be measured by the absolute difference between negative and positive derivative of HI as indicated in the following equation:

$$M = \left| \frac{\text{Number of } (d/dx > 0)}{n - 1} - \frac{\text{Number of } (d/dx < 0)}{n - 1} \right|, M \in [0; 1] \quad (1)$$

where d/dx represents the derivative of the HI, n represents the number of observations, M represents a higher monotonicity of a degradation when it approaches 1.

Trendability. Trendability is related to time and represents the correlation between the degradation trend and the operating time of a component [9], and can be calculated as follow:

$$R = \frac{n(\sum_{i=1}^n x_i t_i) - (\sum_{i=1}^n x_i)(\sum_{i=1}^n t_i)}{\sqrt{[n \sum_{i=1}^n x_i^2 - (\sum_{i=1}^n x_i)^2] [n \sum_{i=1}^n t_i^2 - (\sum_{i=1}^n t_i)^2]}} \quad (2)$$

Table 1. Health indicator construction methods.

Feature type	Computation approaches	Methods	Data
Single feature based HI	Raw signal and residuals	Raw signal of viscosity and dielectric constant [37,38]	Lubrication oil (gearbox)
		Raw signal of oil debris [6]	Lubrication oil (gearbox)
		Power residual [28]	Generated power signal
		Temperature residual [2]	Bearings temperature (Gearbox)
	Time domain features	Root mean square [12,13]	Vibration (bearings)
		Spectral kurtosis [22]	Vibration (bearings)
		Trigonometric functions [9]	Vibration (bearings)
	Time-frequency features	Wavelet packet decomposition [24]	Vibration (bearings)
		Hilbert huang transform [18]	Vibration (bearings)
		Power spectral density [5]	Current signal (gearbox)
Multiple features based HI	Dimension reduction	ISOMAP [3,23]	Vibration (bearings)
		PCA [32]	SCADA data
	Distance between classes	Euclidian and mahalanobis distance [25,26]	Pitch angle (pitch system), voltage (converter)
		Jensen-Renyi distance [4]	Vibration (bearings)

$R \in [-1; 1]$ represents the correlation coefficient between indicator x and the time index t . R approaches 1, when the HI has a strong positive linear correlation with time.

3 Degradation Detection Based on Health Stage Division

The computed HI gives information about the system health (condition and performance). When a degradation occurred (drift from normal condition or

nominal performance) the HI presents an increasing or decreasing trend. Then prognostic module can start because RUL prediction when no fault occurred is unnecessary. The degradation can be detected by dividing the HI into two or multiple stages using a threshold according to the degradation trend. Dividing the health stage using a threshold is widely used in the literature for this task, some works used classification techniques when sufficient degradation data are available in order to estimate the boundary between nominal and degraded conditions (see Table 2). Multiple stage division by considering an intermediate stage is also important in order to confirm the degradation occurrence with a second threshold for avoiding false alarms.

Table 2. Degradation detection methods.

Approaches	Methods	Advantage	Drawback
Threshold	Threshold value [15]	No need for degradation data. Easy for implementation	Difficulty to choose the threshold value in order to achieve early degradation detection and avoid false alarms. Need of an expert for the choice of the threshold value
	Statistical threshold 3σ interval [33]		
Classification	Logistic regression [34]	The boundary between nominal and degraded conditions is estimated automatically	Necessity of system degradation data. Model parameters are difficult to tune
	SVM [22]		

The goal of this division is to (1) identify the stages where the degradation process is active and (2) separate the degradation progress or evolution over time according to its dynamics (fast, slow, decreasing or self-healing, increasing and stable etc.). This division allows to improve the reliability of degradation detection and the RUL estimation.

4 Fault Prognostic (RUL Estimation)

Prognostic aims at estimating the remaining useful life of a component using the built HI. RUL estimation starts when a degradation is detected (drift from the nominal performance). Generally, RUL is estimated based on the use of one of the following two main approaches: Experience based approaches and degradation modeling approaches(see Fig. 2). Experience based prognostic is achieved by applying reliability or similarity based approaches. The degradation modeling can be achieved by using physical models or by data-driven approaches.

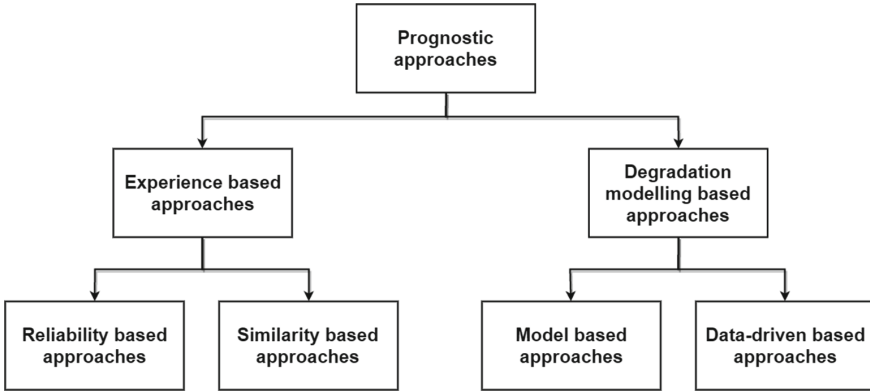


Fig. 2. RUL estimation approaches.

4.1 Experience Based Prognostic

Experience based prognostics methods are based on the use of maintenance or inspection feedback data sets gathered during a significant period of time. They represent the operational conditions during all the degradation process until the failure. In general, they can be classified into reliability based and similarity based approaches. Reliability based approaches employ a statistical failure distribution (i.e., Weibull) in order to fit to the gathered data. A periodic update of the parameters of this failure distribution is performed in order to adjust those parameters according to the experience obtained from the current maintenance practices. The built failure distribution is used for the RUL estimation of components with similar characteristics. Similarity based approaches use a library of degradation patterns for a set of components under different operation conditions. Each degradation pattern represents the degradation development of a component under certain operation conditions until the failure. The data gathered about the operation conditions of a component during a time window is compared to the degradation patterns in order to select the one who fits the best the data within this time window. Then, the RUL is estimated using the selected degradation pattern. Table 3 summarizes some experience based approaches presented in the literature for the prognostics.

Experience-based prognostics methods are efficient when degradation history is available for a system during a long period. The degradation history must represent the health evolution of the system from the healthy state until the failure state (run to failure). Reliability based approaches are not suitable for components showing complex degradation behaviour according to the operation and environment conditions. This is due to the fact that they do not use the online operation data in order to estimate the RUL. Similarity based approaches require also run to failure data history of identical units or components. Comparing to reliability approaches, similarity based approaches use online monitoring data in order to compare it with degradation history and estimate the RUL. They have

Table 3. Experience based approaches.

Approaches	Methods	Application	Advantage	Drawback
Reliability based approach	Weibull distribution [21,35]	Engine	Can monitor the system health state only with the operating cycle of the system	Depends on degradation history. Not adapted for complex systems due several interacting components and varying conditions. Less precise without using monitoring data
Similarity based approach	Similarity distance [29,30]	Electric cooling fan, engineered system	Good precision at component level if suitable data history is available. monitor the current health state of the system	Depends on degradation history. Not adapted for complex systems due several interacting components and varying conditions
	KNN [14,17]	Battery, turbofan, engineered system		
	Fuzzy similarity [39]	Reactor		

the advantage to be easy to implement and precise at the level of components if the latter present the same degradation trend. However, they are not adapted for complex systems due to the varying operation and environment conditions.

4.2 Degradation Modelling Based Approaches

This category of approaches aims at predicting the degradation evolution over time in order to estimate the system failure (end of life), Then the RUL is computed as the time from degradation detection until the failure. Model based approaches use physical and mathematical relations in order to model the degradation trend. These methods are usually used at component level and deal with wearing, crack, and corrosion phenomena. Paris law [16] is the most physics model used for the prediction of wear on rolling element bearing. Data driven approaches transform monitoring data gathered from sensors into relevant information about the system behaviour and dynamics, the mainly used methods are statistical and artificial Intelligence (AI) tools. Statistical techniques estimate the RUL of systems based on empirical knowledge, where artificial intelligence techniques are based on two phases: offline learning phase and online test phase. The model uses a database for training parameters in the offline phase, after that the online phase estimates the current health state of the system and predict its future state (evolution) over time. These methods are increasingly used

due to their ability to find relation between data by training the model using datasets. Degradation modelling methods used in the literature are summarized in Table 4.

Table 4. Degradation modeling approaches.

Approaches		Methods	Application	Advantage	Drawback
Physical model based approach		Paris law [7,8]	WT blades, gearbox bearings	Ability for interpretation by physics. Provide accurate RUL at component level prognostics	Detailed knowledge of the system behaviour is required. Complex systems degradation model is hard for construction
Data driven approach	Statistical methods	Moving average [6]	Gearbox	Understanding the degradation mechanism is not required. Effective in describing the uncertainty of the degradation process	Highly depends on the trend information of historical observations. Less precise in the RUL prediction of complex systems
		ARMA [34]	Engine		
		Bayesian filter [14]	Battery, turbofan engine		
		Particle filter [40]	Mechanical component		
	Artificial intelligence methods	RNN [9,27]	Gearbox, Bearings	Able to learn complex nonlinear relationship between data. Understanding the degradation mechanism is not required. Expected to have a good performance in the RUL prediction of complex systems	Need sufficient data for training. Lack of physical meaning. Difficulty to select the parameters of the model
		ANFIS [31]	Gearbox shaft and gears		
		SVR [3,18,22]	Bearings		
		HMM [24]	Bearings		

Degradation modeling approaches use online monitoring data in order to observe the current health state of the system. Degradation evolution prediction is allowed when degradation of the system is detected. Model based degradation approaches are used generally at component level prognostic, where they gives more precision but they require extensive experimentation and model verification. These models are reliable when the system state have not been changed or upgraded. The models can be interpreted because its parameters are extracted from the system physics. However, it is difficult to generate degradation behaviour especially for complex system where several phenomena take place into the system. Data-driven based approaches are considered as black box models where the relation between input and output is complex and is hard for interpretation, but they can be used when the system is complex and where developing an accurate physical or mathematical model is not feasible. At component level, they can be less precise than the model based approaches, However, they are more suitable and efficient for complex systems whose degradation process is too hard to be modeled and represented by physical models.

5 Prognostic Metrics

When the RULs are predicted online for each sample of time, RULs must be evaluated using suitable and meaningful metrics. Root Mean Square Error (RMSE) and Mean Absolute Percentage Error (MAPE) are widely used in the literature for RUL evaluation depending on the true RUL.

$$RMSE = \sqrt{\frac{1}{n} \sum_{t=1}^n (r^l(t) - r_*^l(t))^2} \tag{3}$$

$$MAPE = \frac{100\%}{n} \sum_{t=1}^n \left| \frac{r^l(t) - r_*^l(t)}{r^l(t)} \right| \tag{4}$$

Where n is the number of observations, t is the time index, r_*^l represents the true RUL, and r^l represents the predicted RUL.

In [19], new metrics for prognostics performance evaluation are proposed. The most relevant metrics are: Prognostic Horizon, $\alpha - \lambda$ Performance, Relative Accuracy, and Cumulative Relative Accuracy. Prognostic Horizon (PH) is the difference between the current time index when the degradation is detected and the time of end of life (EoL). $\alpha - \lambda$ performance can determine whether the prediction falls within specified limits at particular times. Relative prediction accuracy is the errors between the predicted RUL relative to the actual (true) RUL at a specific time index. Cumulative Relative Accuracy CRA evaluates the RUL at multiple time instances. CRA is computed as the weighted sum of relative accuracies at multiple time instances.

6 Conclusion

The paper presents an overview of fault prognostic approaches for the monitoring and predictive maintenance of WTs. The fault prognostics of WTs is a challenging task because of their dynamics complexity, their different operating conditions, and the strong variability of their environment. The discussed prognostic approaches in this paper are compared according to their potential requirements in Table 5, where each requirement can be “Required”, “Not required”, and “Beneficial” for each prognostics approach.

Table 5. Prognostic approaches requirements.

Approaches	Engineering model	Degradation history	Current health state	Degradation detection
Reliability	Not required	Required	Not required	Not required
Similarity	Not required	Required	Required	Beneficial
Model based	Required	Beneficial	Required	Required
Data-driven	Not required	Beneficial	Required	Required

Table 6 presents a comparison between the four prognostics approaches in terms of precision, applicability, cost, and interpretability. For precision criteria, also component level and system level prognostic are compared for each prognostic approach, where (+) refers to the advantage and (−) refers to the drawback of the methods.

Table 6. Prognostic approaches comparison.

Approaches	Precision and applicability		Implementation	Cost	Interpretability
	Component level	System level			
Reliability	+	−	++	--	−
Similarity	+	−	++	--	−
Model	++	+	−	−	+
Data-driven	+	++	+	+	−

Experience based approaches (Reliability and similarity) are easier to apply when degradation history is available, but less precise at system level prognostic due to the variability of operation and environment conditions. Degradation modelling approaches are divided into model based and data driven approaches. Model based prognostic may have a good precision at component level (i.e., crack propagation of bearings). Although, when the system is more complex, this kind of approaches may not be precise or even applicable. Despite of the lack of interpretability of the data-driven approaches, they are the most suitable to perform the prognostic task of complex dynamic systems such as wind turbines.

Even with the increasing number of publications of fault prognostics for the predictive maintenance of WTs, several challenges still require to be addressed. Examples of these challenges are: how to ensure the prognostic when no a priori knowledge about the degradation behaviour is available (i.e., new installed system), which HI construction method is suitable for this case, the choose of the threshold value is also difficult and predicting the degradation evolution without a priori information about it is challenging.

The use of concept drift techniques can be an alternative solution to contribute addressing these challenges. They can be used in order to construct a HI and detect the drift from nominal conditions. When sufficient data about degradation is collected, the feature which fits the best the monotonicity and trendability during the degradation must be selected as HI. The threshold value must be chosen in order to detected the degradation as early as possible while avoiding the maximum of false alarms. In additions, multiple stage division should be considered in order to confirm the degradation occurrence. The degradation prediction model must also be updated with the collected incoming data in order to improve the performance of the prediction (precision). It is worth to mention that another challenge for fault prognostics is related to the RUL estimation for complex system due to the multiple interactions between their individual components. (see Fig. 3). Another challenge is related to the development of

a post-prognostic phase in order to interpret prognostic results to the human operators by using a natural language.

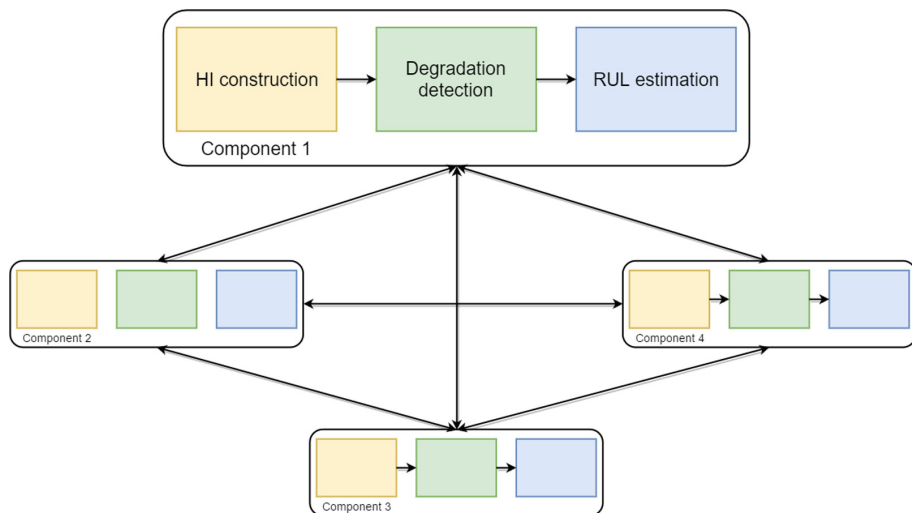


Fig. 3. Prognostic for complex system.

Acknowledgments. This work is supported by the European Union - European Regional Development Fund.

References

1. Annual combined onshore and offshore wind energy statistics. <https://windeurope.org/about-wind/statistics/european/wind-in-power-2017>. Accessed 26 June 2018
2. Bangalore, P., Tjernberg, L.B.: An artificial neural network approach for early fault detection of gearbox bearings. *IEEE Trans. Smart Grid* **6**(2), 980–987 (2015)
3. Benkedjough, T., Medjaher, K., Zerhouni, N., Rechak, S.: Remaining useful life estimation based on nonlinear feature reduction and support vector regression. *Eng. Appl. Artif. Intell.* **26**(7), 1751–1760 (2013)
4. Bošković, P., Gašperin, M., Petelin, D., Juričić, Đ.: Bearing fault prognostics using rényi entropy based features and Gaussian process models. *Mech. Syst. Sig. Process.* **52**, 327–337 (2015)
5. Cheng, F., Qu, L., Qiao, W.: Fault prognosis and remaining useful life prediction of wind turbine gearboxes using current signal analysis. *IEEE Trans. Sustain. Energy* **9**(1), 157–167 (2018)
6. Dupuis, R.: Application of oil debris monitoring for wind turbine gearbox prognostics and health management. In: *Annual Conference of the Prognostics and Health Management Society*, pp. 10–16 (2010)

7. Florian, M., Sørensen, J.D.: Wind turbine blade life-time assessment model for preventive planning of operation and maintenance. *J. Mar. Sci. Eng.* **3**(3), 1027–1040 (2015)
8. Grujicic, M., Galgalikar, R., Ramaswami, S., Snipes, J., Chenna, V., Yavari, R.: Finite-element analysis of horizontal-axis wind-turbine gearbox failure via tooth-bending fatigue. *Int. J. Mater. Mech. Eng.* **3**, 6–15 (2014)
9. Javed, K., Gouriveau, R., Zerhouni, N., Nectoux, P.: Enabling health monitoring approach based on vibration data for accurate prognostics. *IEEE Trans. Ind. Electron.* **62**(1), 647–656 (2015)
10. Kusiak, A., Zheng, H., Song, Z.: On-line monitoring of power curves. *Renew. Energy* **34**(6), 1487–1493 (2009)
11. Lei, Y., Li, N., Guo, L., Li, N., Yan, T., Lin, J.: Machinery health prognostics: a systematic review from data acquisition to RUL prediction. *Mech. Syst. Signal Process.* **104**, 799–834 (2018)
12. Lei, Y., Li, N., Lin, J.: A new method based on stochastic process models for machine remaining useful life prediction. *IEEE Trans. Instrum. Meas.* **65**(12), 2671–2684 (2016)
13. Malhi, A., Yan, R., Gao, R.X.: Prognosis of defect propagation based on recurrent neural networks. *IEEE Trans. Instrum. Meas.* **60**(3), 703–711 (2011)
14. Mosallam, A., Medjaher, K., Zerhouni, N.: Data-driven prognostic method based on bayesian approaches for direct remaining useful life prediction. *J. Intell. Manuf.* **27**(5), 1037–1048 (2016)
15. Niu, G., Yang, B.S.: Intelligent condition monitoring and prognostics system based on data-fusion strategy. *Expert. Syst. Appl.* **37**(12), 8831–8840 (2010)
16. Paris, P., Erdogan, F.: A critical analysis of crack propagation laws. *J. Basic Eng.* **85**(4), 528–533 (1963)
17. Ramasso, E., Rombaut, M., Zerhouni, N.: Joint prediction of continuous and discrete states in time-series based on belief functions. *IEEE Trans. Cybern.* **43**(1), 37–50 (2013)
18. Saidi, L., Ali, J.B., Bechhoefer, E., Benbouzid, M.: Wind turbine high-speed shaft bearings health prognosis through a spectral kurtosis-derived indices and SVR. *Appl. Acoust.* **120**, 1–8 (2017)
19. Saxena, A., et al.: Metrics for evaluating performance of prognostic techniques. In: *International Conference on Prognostics and Health Management, PHM 2008*, pp. 1–17. IEEE (2008)
20. Sayed-Mouchaweh, M.: *Learning from Data Streams in Dynamic Environments*. Springer, Heidelberg (2016). <https://doi.org/10.1007/978-3-319-25667-2>
21. Schömig, A.K., Rose, O.: On the suitability of the Weibull distribution for the approximation of machine failures. In: *Proceedings of IIE Annual Conference*, p. 1. Institute of Industrial and Systems Engineers (IISE) (2003)
22. Soualhi, A., Medjaher, K., Zerhouni, N.: Bearing health monitoring based on Hilbert-Huang transform, support vector machine, and regression. *IEEE Trans. Instrum. Meas.* **64**(1), 52–62 (2015)
23. Tenenbaum, J.B., De Silva, V., Langford, J.C.: A global geometric framework for nonlinear dimensionality reduction. *Science* **290**(5500), 2319–2323 (2000)
24. Tobon-Mejia, D.A., Medjaher, K., Zerhouni, N., Tripot, G.: A data-driven failure prognostics method based on mixture of Gaussians hidden Markov models. *IEEE Trans. Reliab.* **61**(2), 491–503 (2012)
25. Toubakh, H., Sayed-Mouchaweh, M.: Hybrid dynamic data-driven approach for drift-like fault detection in wind turbines. *Evol. Syst.* **6**(2), 115–129 (2015)

26. Toubakh, H., Sayed-Mouchaweh, M.: Hybrid dynamic classifier for drift-like fault diagnosis in a class of hybrid dynamic systems: application to wind turbine converters. *Neurocomputing* **171**, 1496–1516 (2016)
27. Tse, P., Atherton, D.: Prediction of machine deterioration using vibration based fault trends and recurrent neural networks. *J. Vib. Acoust.* **121**(3), 355–362 (1999)
28. Uluyol, O., Parthasarathy, G., Foslien, W., Kim, K.: Power curve analytic for wind turbine performance monitoring and prognostics. *Annu. Conf. Progn. Health Manag. Soc.* **2**, 1–8 (2011)
29. Wang, P., Youn, B.D., Hu, C.: A generic probabilistic framework for structural health prognostics and uncertainty management. *Mech. Syst. Sig. Process.* **28**, 622–637 (2012)
30. Wang, T., Yu, J., Siegel, D., Lee, J.: A similarity-based prognostics approach for remaining useful life estimation of engineered systems. In: *International Conference on Prognostics and Health Management, PHM 2008*, pp. 1–6. IEEE (2008)
31. Wang, W.Q., Golnaraghi, M.F., Ismail, F.: Prognosis of machine health condition using neuro-fuzzy systems. *Mech. Syst. Signal Process.* **18**(4), 813–831 (2004)
32. Wang, Y., Ma, X., Joyce, M.J.: Reducing sensor complexity for monitoring wind turbine performance using principal component analysis. *Renew. Energy* **97**, 444–456 (2016)
33. Wang, Y., Peng, Y., Zi, Y., Jin, X., Tsui, K.L.: A two-stage data-driven-based prognostic approach for bearing degradation problem. *IEEE Trans. Ind. Inform.* **12**(3), 924–932 (2016)
34. Yan, J., Koc, M., Lee, J.: A prognostic algorithm for machine performance assessment and its application. *Prod. Plan. Control.* **15**(8), 796–801 (2004)
35. Zhai, L.Y., Lu, W.F., Liu, Y., Li, X., Vachtsevanos, G.: Analysis of time-to-failure data with Weibull model in product life cycle management. In: Nee, A., Song, B., Ong, S.K. (eds.) *Re-engineering Manufacturing for Sustainability*, pp. 699–703. Springer, Heidelberg (2013). https://doi.org/10.1007/978-981-4451-48-2_114
36. Zhang, B., Zhang, L., Xu, J.: Degradation feature selection for remaining useful life prediction of rolling element bearings. *Qual. Reliab. Eng. Int.* **32**(2), 547–554 (2016)
37. Zhu, J., Yoon, J., He, D., Qiu, B., Bechhoefer, E.: Online condition monitoring and remaining useful life prediction of particle contaminated lubrication oil. In: *2013 IEEE Conference on Prognostics and Health Management (PHM)*, pp. 1–14. IEEE (2013)
38. Zhu, J., Yoon, J.M., He, D., Qu, Y., Bechhoefer, E.: Lubrication oil condition monitoring and remaining useful life prediction with particle filtering. *Int. J. Progn. Health Manag.* **4**, 124–138 (2013)
39. Zio, E., Di Maio, F.: A data-driven fuzzy approach for predicting the remaining useful life in dynamic failure scenarios of a nuclear system. *Reliab. Eng. Syst. Saf.* **95**(1), 49–57 (2010)
40. Zio, E., Peloni, G.: Particle filtering prognostic estimation of the remaining useful life of nonlinear components. *Reliab. Eng. Syst. Saf.* **96**(3), 403–409 (2011)